


5 Testing and Evaluation Results

5.1. RESULTS AND OBSERVATIONS

The data is shown in Table below.

Source room:	Temperature	21°C	Receiving Room:	Temperature	21°C
	R.H.	80%		R.H.	80%
				Volume	121 m ³

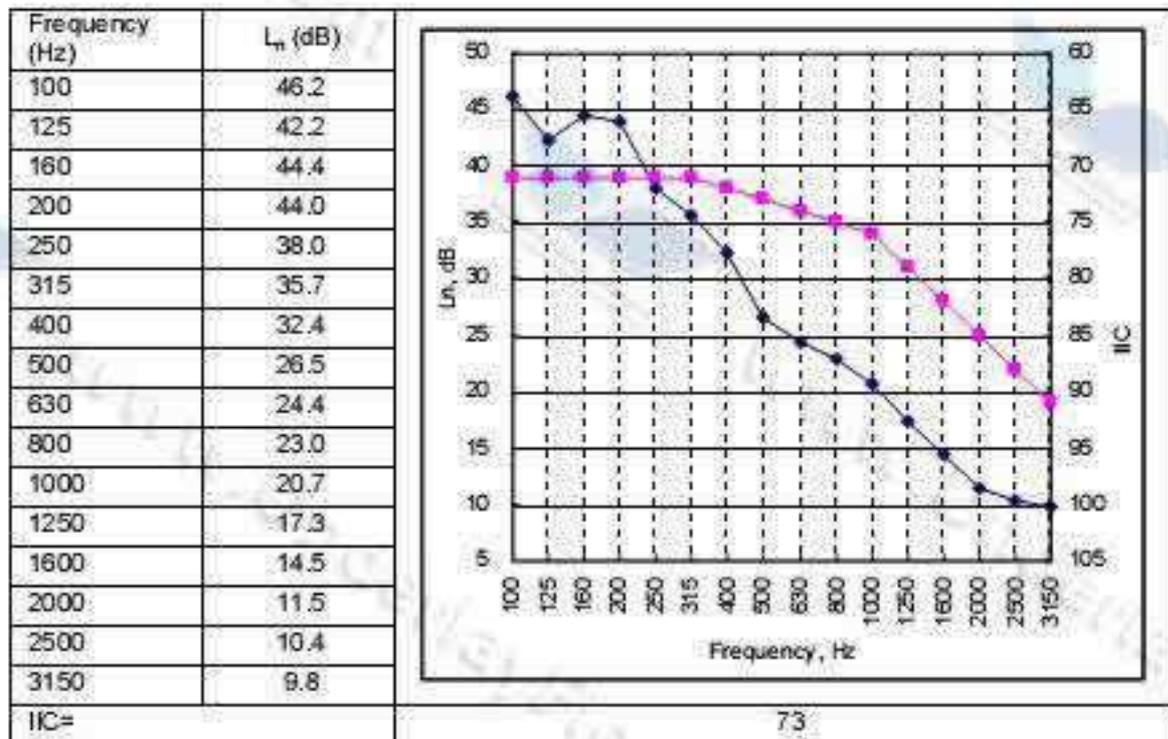

Impact Insulation Class: IIC 73 in accordance with ASTM E989-12

Note:

1. L_n = Normalized Sound Pressure Level
2. The IIC was based on the floor assembly consisted of more than 500mm thickness systems described in section 4.3.